


1000 GALLON H-2O MONOLITHIC OIL-WATER SEPARATOR



DESIGN NOTES:

- 1) JOINT IS ABOVE LIQUID LEVEL AND SEALED WITH PETROLEUM RESISTANT SEALANT
- 2) INTERIOR OF TANK IS COATED WITH PETROLEUM RESISTANT EPOXY SEALANT.
- 3) EXTERIOR OF TANK IS COATED WITH WATER PROOF CONCRETE SEALANT.
- 4) INLETS AND OUTLETS CAN BE CORE DRILLED FOR 6" AND 8" BOOTS WITH CLAMPS.
- 5) BAFFLES SUPPLIED BY OTHERS.
- 6) MEETS CURRENT ASTM 1227
- 7) CONCRETE STRENGTH 5000 PSI MIN. AT 28 DAYS
- 8) MEETS H-2O WHEEL LOAD REQUIREMENTS
- 9) REBAR: ASTM A-615 GRADE 60

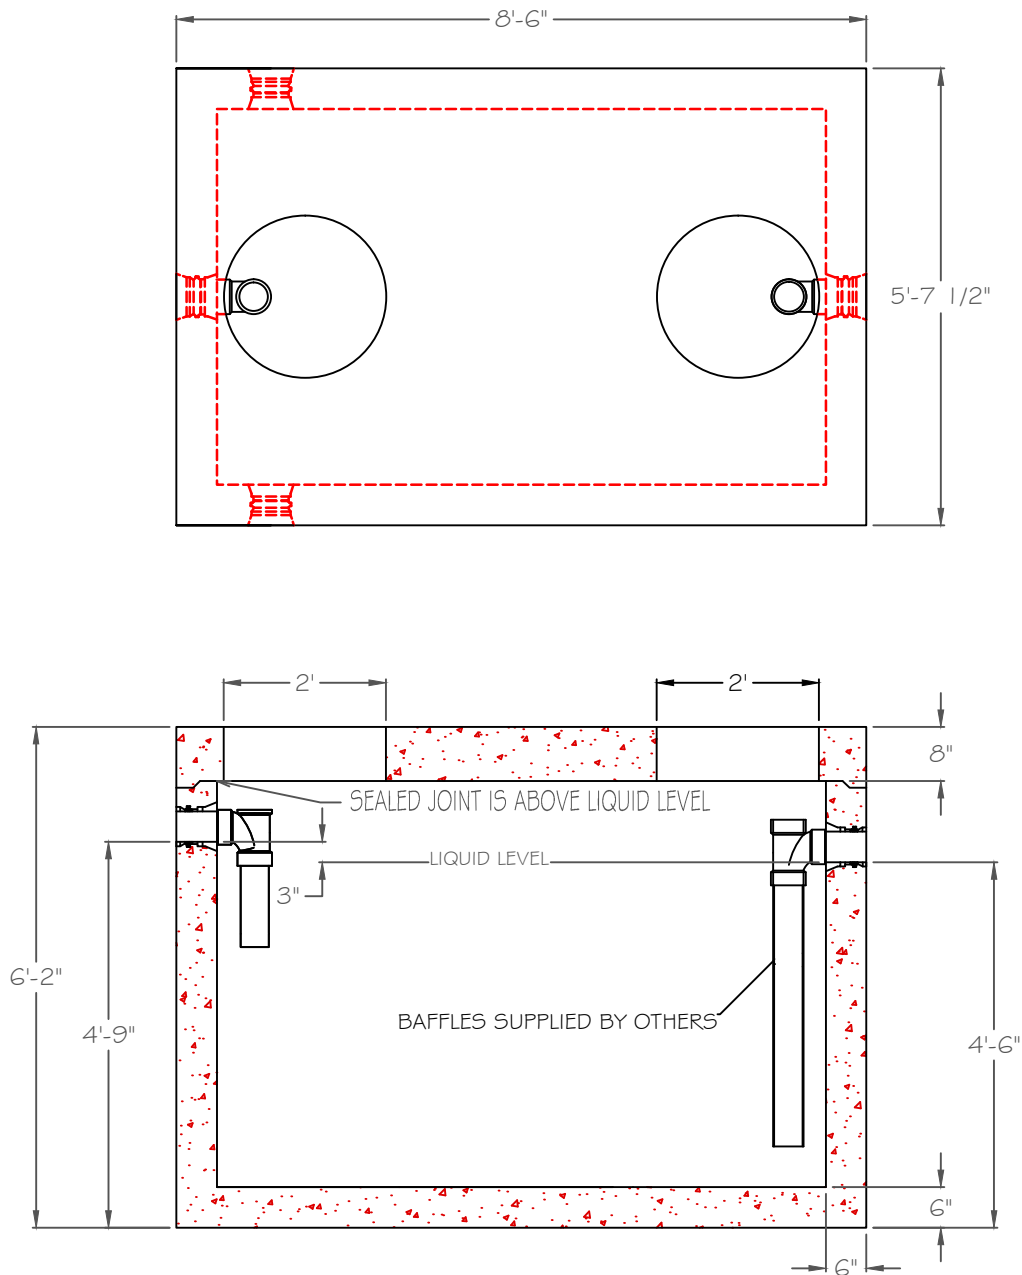

JOLLEY PRECAST INC.
1-800-582-4638