


2000 GALLON TWO COMPARTMENT OSI SEPTIC TANK



DESIGN NOTES:

- 1) ALL JOINTS SEALED WITH BUTYL RUBBER SEALANT
- 2) ALL INLETS AND OUTLETS HAVE STATE APPROVED SEALS
- 3) TANK INCLUDES CAST IN PLACE 24" OSI RISER ADAPTERS
- 4) MEETS CURRENT ASTM C 1227
- 5) CONCRETE STRENGTH 5000 PSI MIN. AT 28 DAYS
- 6) TANK WILL ACCEPT OSI BIOTUBE® FILTER, NOT INCLUDED.

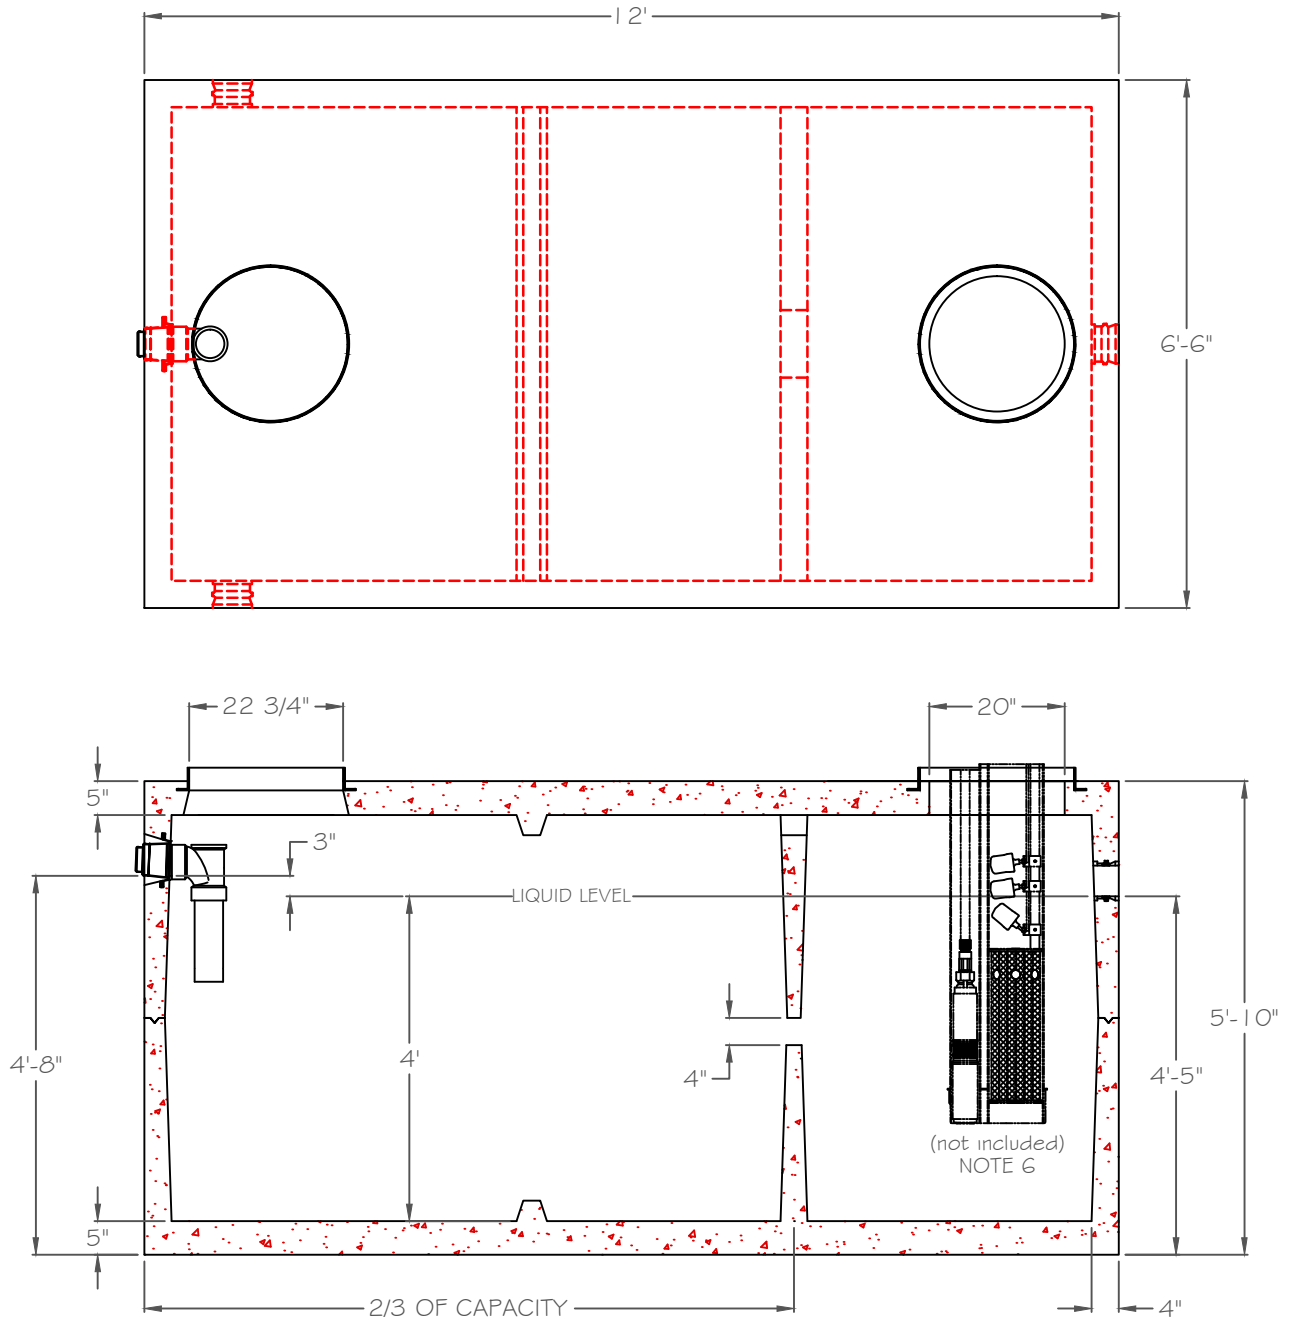